

# MANDÍK<sup>®</sup>

## ROUND TIGHT REGULATION ADJUSTMENT DAMPER

### RKKTM




These technical conditions define the range of produced dimensions and versions of "ROUND TIGHT REGULATION ADJUSTMENT DAMPERS RKKTM"("further only dampers"). These technical conditions apply to the manufacture, design, ordering, assembly, operation and maintenance.

**I. CONTENT**


<b>II. GENERAL</b>	<b>3</b>
1. Description.....	3
2. Design.....	3
3. Dimensions and weights.....	4
4. Placement and installation.....	6
<b>III. TECHNICAL DATA</b>	<b>6</b>
5. Basic parametrs.....	6
6. Electrical components, wiring diagram.....	7
7. Pressure losses.....	9
8. Noise data.....	10
<b>IV. MATERIAL, FINISHING</b>	<b>11</b>
9. Material.....	11
10. Finishing.....	11
<b>V. CHECKING, TESTING</b>	<b>11</b>
11. Checking.....	11
12. Testing.....	11
<b>VI. PACKING, TRANSPORT AND STORAGE</b>	<b>11</b>
13. Logistical data.....	11
<b>VII. ASSEMBLY</b>	<b>11</b>
14. Assembly.....	11
<b>VIII. ORDERING INFORMATION</b>	<b>12</b>
15. Ordering key.....	12

## II. GENERAL

**Fig. 1** Damper RKKTM version SPIRO pipeline with servo actuator

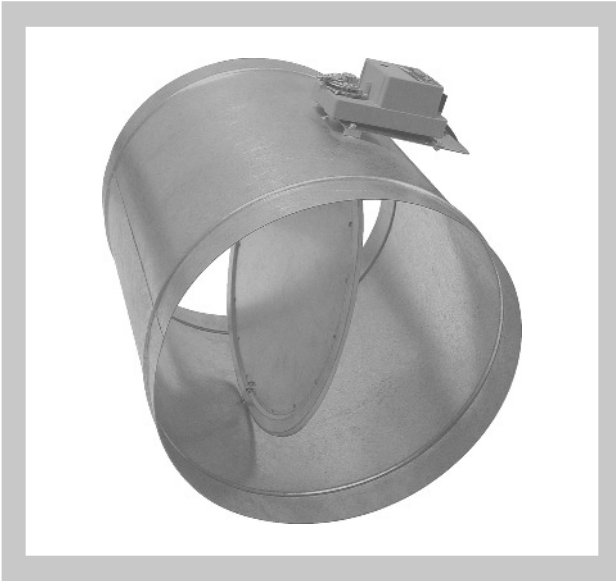

**Fig. 2** Damper RKKTM with manually control and flange

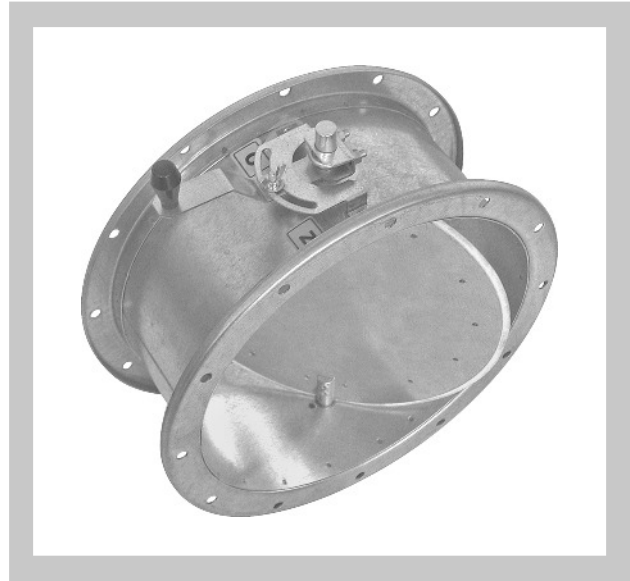

### 1. Description

- 1.1.** The dampers consist of the body, the leaf fitted according to the sealing circumference and the control mechanism.

They serve the tight sealing of air piping or the regulation of the air flow in the piping by constricting the cross section.

External Casing leakage class C.

Tightness through the damper blade: class 4

Tightness through the damper blade ATEX: from dimension DN80 - DN315, class 3.  
from dimension DN355 - DN630, class 4.

- 1.2.** The dampers are destined for maximal velocity of air flow  $12 \text{ m}\cdot\text{s}^{-1}$ .
- 1.3.** The dampers are intended for environment protected against weather impacts with the classification of climatic conditions class 3K5, without condensation, frost, ice formation, and without water even from other sources than rain according to EN 60 72133, change A2.

The air flowing through the dampers must not contain solid, fibrous, adhesive or aggressive particles, and its temperature must lie in the range of  $-20^{\circ}\text{C}$  to  $+80^{\circ}\text{C}$ .

- 1.4.** If is not noticed other way, all dimensions and weight are in millimeters and kilograms.

### 2. Design

- 2.1.** Versions of dampers are shown in the table Tab. 15.1.1. The version is designated by two digits following the TP mark.

- 2.2.** According to manner of attachment:

- on cylindrical piping with flanges according to EN 12 220
- on spiro piping
- on spiro piping with edge sealing

3. Dimensions and weights

3.1. Damper for connecting to cylindrical piping

Tab. 3.1.1. Dimensions, weights and effective area

Size $\varnothing D$	Dimensions			Number of holes n	Effective area $S_{ef}$ [m <sup>2</sup> ]	Weights [kg]
	L	a	$\varnothing d$			
80	150	-	110	4	0,0047	0,92
100	150	-	130	4	0,0074	1,07
110	150	-	140	4	0,0090	1,22
125	150	-	155	8	0,0117	1,39
140	150	-	170	8	0,0147	1,54
160	150	-	195	8	0,0194	1,88
180	150	10	215	8	0,0246	2,23
200	150	20	235	8	0,0305	2,51
225	150	32,5	260	8	0,0387	2,86
250	150	45	285	8	0,0479	3,23
280	150	60	315	8	0,0603	3,66
300	150	70	335	12	0,0693	4,01
315	150	77,5	350	12	0,0765	4,27
355	150	97,5	390	12	0,0973	4,95
400	200	95	445	12	0,1238	6,75
450	200	120	495	12	0,1569	7,80
500	200	145	545	16	0,1940	9,00
560	200	175	605	16	0,2437	10,40
630	200	210	680	16	0,3088	12,80

Damper for connecting to cylindrical piping with flanges according to EN 12 220.

Fig. 3 Damper with manual control mechanism


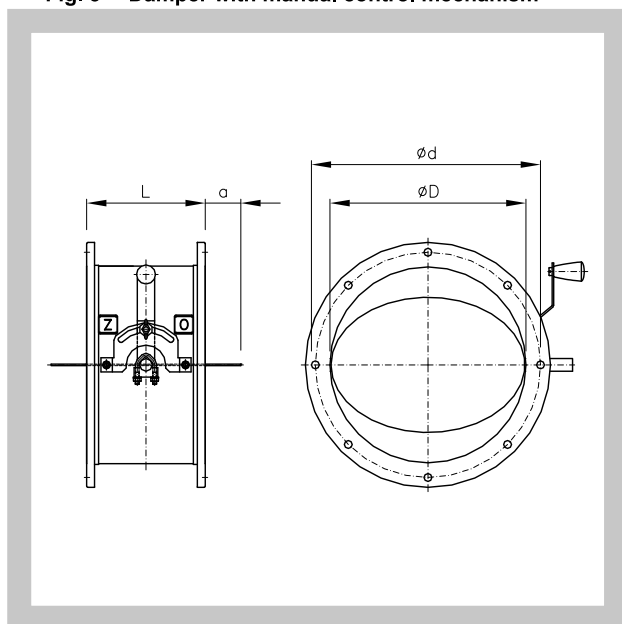


Fig. 4 Damper with control by actuating

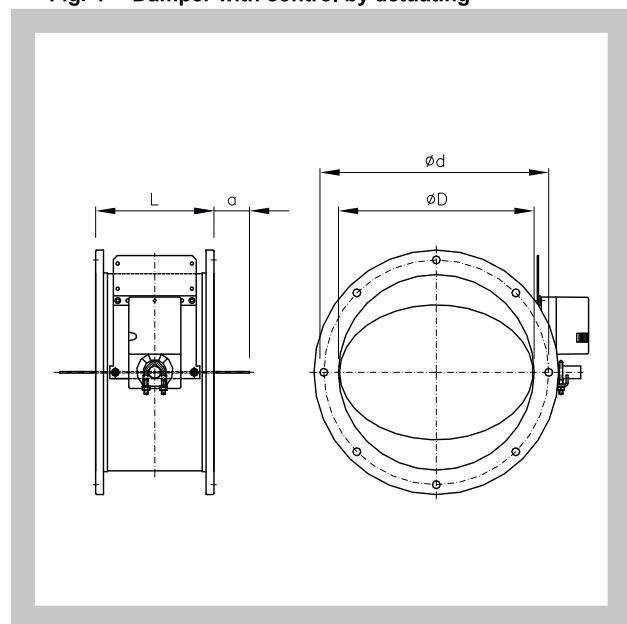


3.2. Damper for connecting to spiro

Tab. 3.2.1. Dimensions, weights and effective area

Size ø D	Dimensions			Effective area S <sub>ef</sub> [m <sup>2</sup> ]	Weights [kg]
	ø D <sub>1</sub>	L <sub>1</sub>	a		
80	79	240	-	0,0047	0,80
100	99	240	-	0,0074	0,95
110	109	240	-	0,0090	1,10
125	124	240	-	0,0117	1,20
140	139	240	-	0,0147	1,35
150	149	240	-	0,0170	1,45
160	159	240	-	0,0194	1,55
180	179	240	-	0,0246	1,80
200	199	240	-	0,0305	2,05
225	224	240	-	0,0387	2,30
250	249	240	-	0,0479	2,60
280	279	240	15	0,0603	3,90
300	299	240	25	0,0693	4,20
310	309	240	30	0,0740	4,40
315	314	240	32	0,0765	4,50
355	354	240	52	0,0973	5,20
400	399	300	45	0,1238	8,60
450	449	300	70	0,1569	9,90
500	499	300	95	0,1940	11,30
560	559	300	125	0,2437	13,00
630	629	300	160	0,3088	15,20


Fig. 5 Damper with manual control mechanism

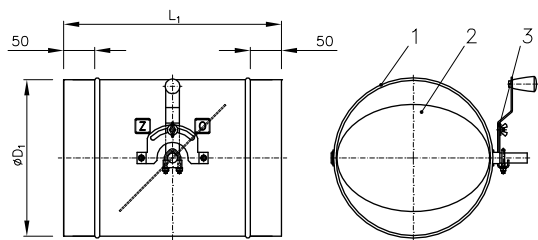

**Position:**

- 1. body of control damper
- 2. sealing leaf of damper
- 3. control lever
- 4. actuator

Fig. 6 Damper with control by actuating

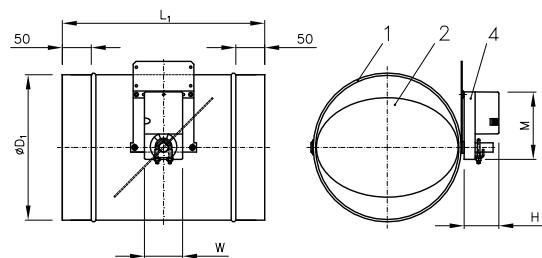

**Position:**

- 1. body of control damper
- 2. sealing leaf of damper
- 3. control lever
- 4. actuator

Dampers with actuator are set up by rectangular pin 10 mm.

- 3.3.** Effective area in Tab. 3.1.1. a 3.2.1. valid for fully opened damper  $S_{ef}$  [m<sup>2</sup>].  
 Open blade exceeds the damper body on both sides of value "a".  
 The weights listed in the table are valid for the basic version (manually controlled). The weight of the servo actuator must be added to all other versions – see table 6.1.1.  
 Atypical dimensions the circular regulation dampers are not manufactured.

**4. Placement and installation**

- 4.1.** The dampers are meant for installation in air piping. The operating position is whatever you like.
- 4.2.** The minimum space for the control mechanism is 250 mm.
- 4.3.** When positioning the dampers in piping, it is necessary to respect the value "a" (overlap of open leaf). The value "a" is listed in Tab. 3.1.1. a 3.2.1.

**III. TECHNICAL DATA**

**5. Basic parameter**

- 5.1.** The maximum pressure difference and the speed of the air flow

Tab. 5.1.1 The maximum pressure difference and the speed of the air flow

Size	Max. Pressure difference $\Delta p$ [Pa]	Maximum speed of air flow $w_{max}$ [m.s <sup>-1</sup> ]
80	1500	15
100	1500	15
110	1500	15
125	1500	15
140	1500	15
150*	1500	15
160	1500	15
180	1500	15
200	1500	15
225	1500	15
250	1500	12
280	1500	12
300	1500	12
310*	1500	12
315	1500	12
355	1500	12
400	1200	10
450	1200	10
500	1200	10
560	1000	10
630	1000	10

\*this version manufactured only on spiro piping

## 6. Electrical components, wiring diagram

### 6.1. Types and weights of the actuators for regulation dampers

Tab. 6.1.1. Types and weights of the actuators

Dampers	Type of actuator	Signalling of position	Torque	Weights of actuator [kg]	Dimensions M x H x W
Size from 80 to 315	Belimo LM230A-S	YES	5 Nm	0,59	116 x 61 x 66
	Belimo LM230A	NO		0,50	
	Belimo LM24A-S	YES		0,58	
	Belimo LM24A	NO		0,49	
	Belimo LM24A-SR	YES		0,51	
Size from 355 to 500	Belimo NM 230A-S (.46)	YES	10 Nm	0,85	124 x 62 x 80
	Belimo NM 230A (.45)	NO		0,80	
	Belimo NM 24A-S (.56)	YES		0,85	
	Belimo NM 24A (.55)	NO		0,75	
	Belimo NM 24A-SR (.57)	YES		0,80	
Size from 560 to 630	Belimo SM 230A-S (.46)	YES	20 Nm	1,10	139 x 64 x 88
	Belimo SM 230A (.45)	NO		1,05	
	Belimo SM 24A-S (.56)	YES		1,05	
	Belimo SM 24A (.55)	NO		1,00	
	Belimo SM 24A-SR (.57)	YES		1,05	

### 6.2. Supply voltage and power inputs

Tab. 6.2.1. Supply voltage and power input

Type of actuator	Supply voltage	Power input		
		In operation	Resting position	Dimensioning
NM 230A, NM 230A-S	AC 100 ... 240 V, 50/60 Hz	2,5 W	0,6 W	6 VA
NM 24A, NM 24A-S	AC 24 V, 50/60 Hz; DC 24 V	1,5 W	0,2 W	3,5 VA
NM 24A-SR	AC 24 V, 50/60 Hz; DC 24 V	2,0 W	0,4 W	4 VA
SM 230A, SM 230A-S	AC 100 ... 240 V, 50/60 Hz	2,5 W	0,6 W	6 VA
SM 24A, SM 24A-S	AC 24 V, 50/60 Hz; DC 24 V	2,0 W	0,2 W	4 VA
SM 24A-SR	AC 24 V, 50/60 Hz; DC 24 V	2,0 W	0,4 W	4 VA

6.3. Wiring diagram of servo actuators Belimo

Fig. 7 Wiring diagram of servo actuators Belimo NM 230A and SM 230A

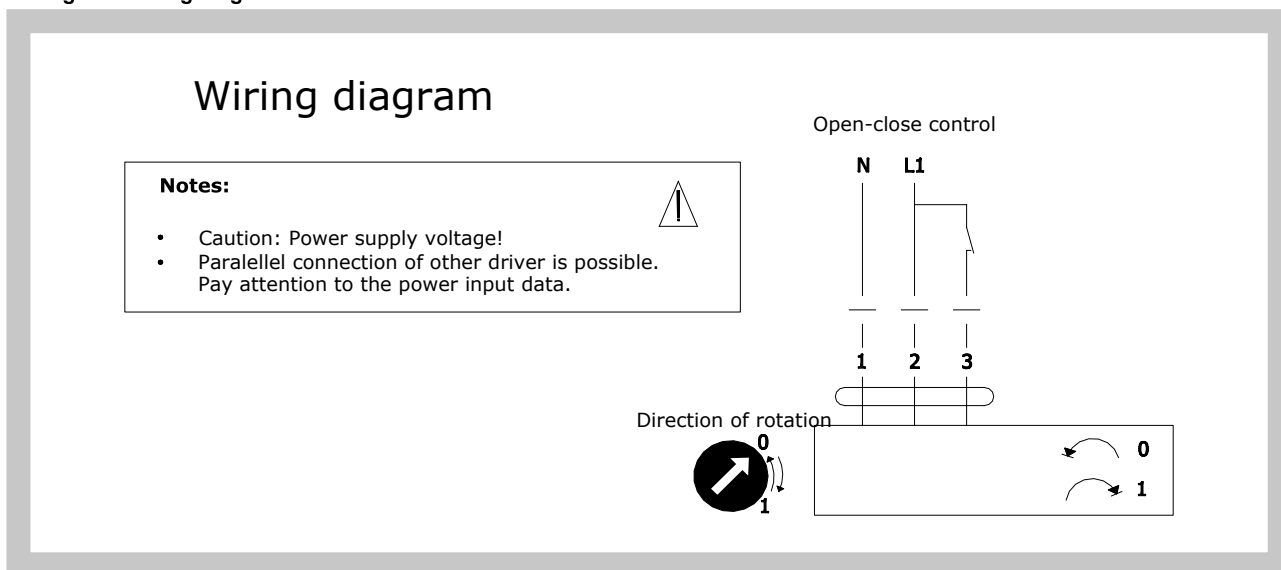


Fig. 8 Wiring diagram of servo actuators Belimo NM 230A-S and SM 230A-S

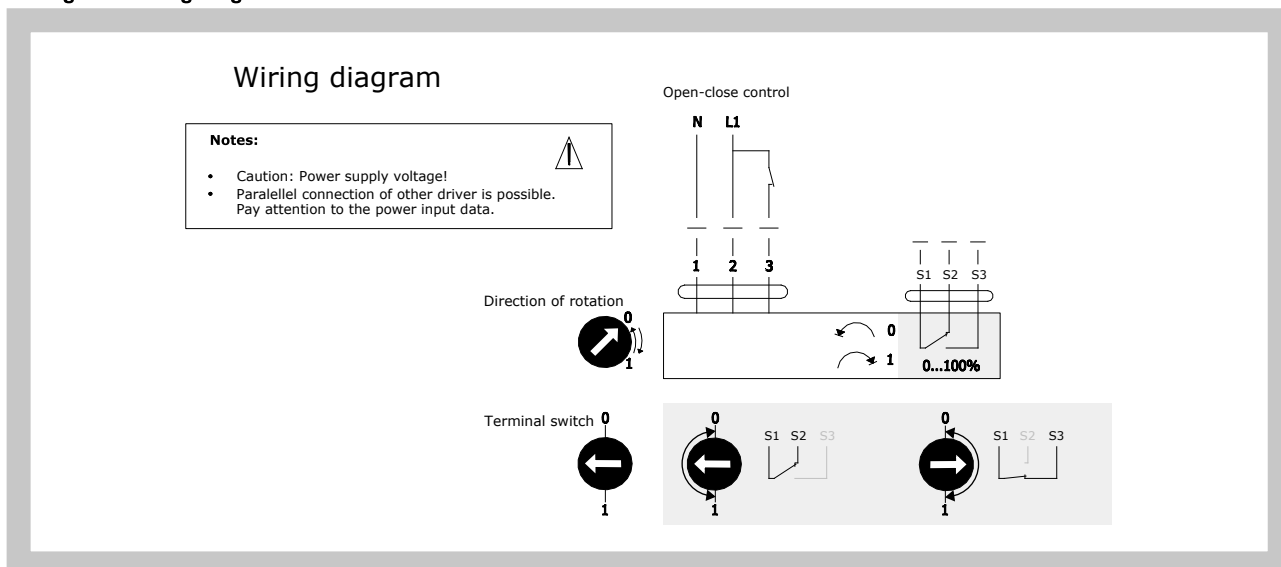


Fig. 9 Wiring diagram of servo actuators Belimo NM 24A and SM 24A

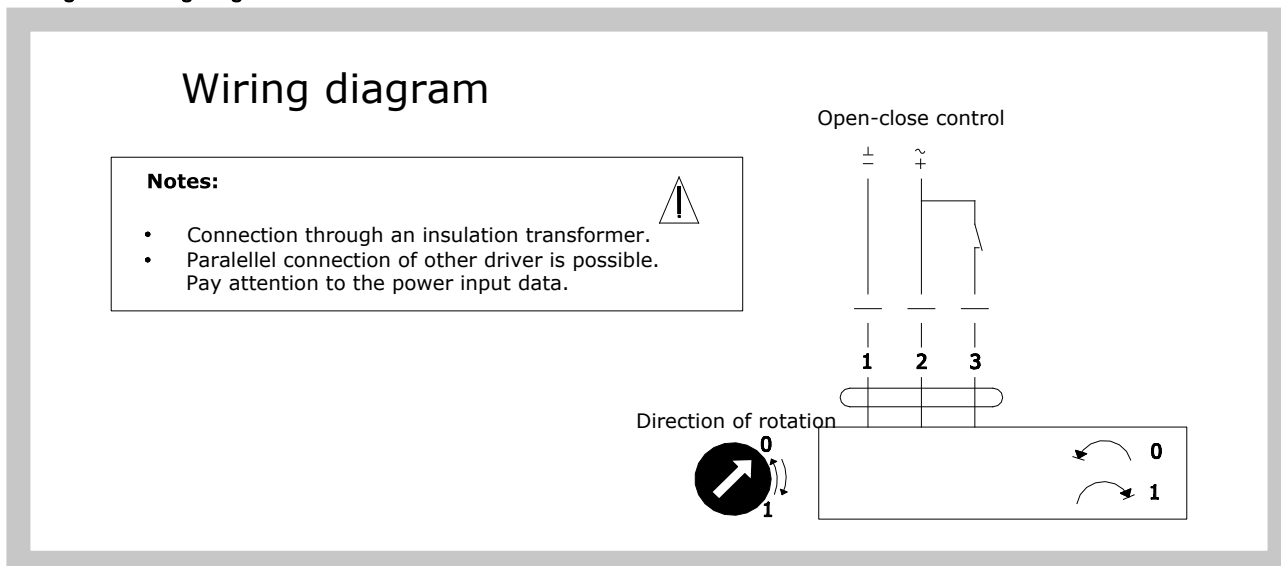




Fig. 10 Wiring diagram of servo actuators Belimo NM 24A-S and SM 24A-S


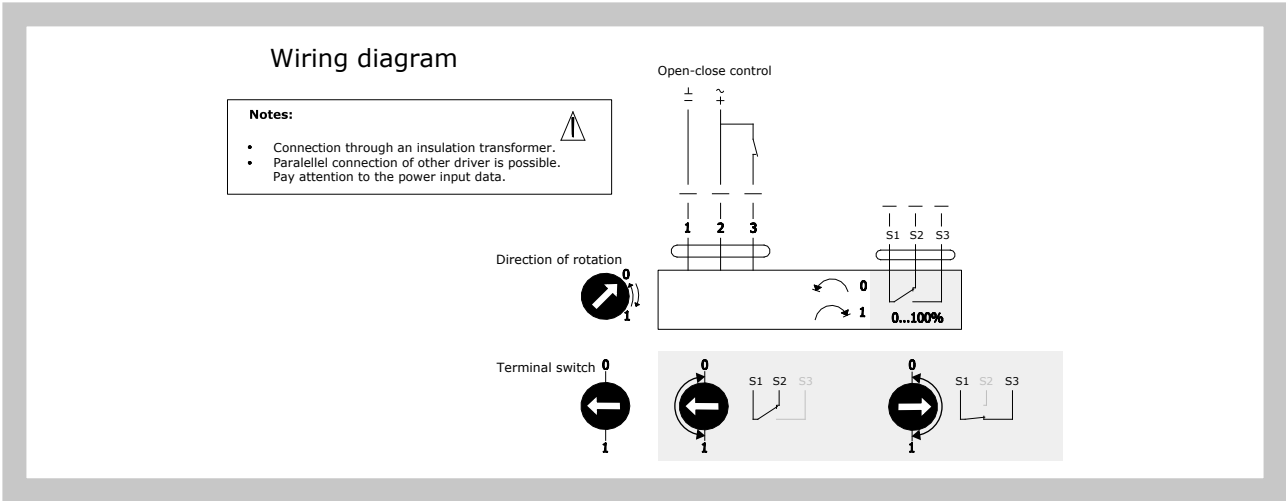



Fig. 11 Wiring diagram of servo actuators Belimo NM 24A-SR and SM 24A-SR

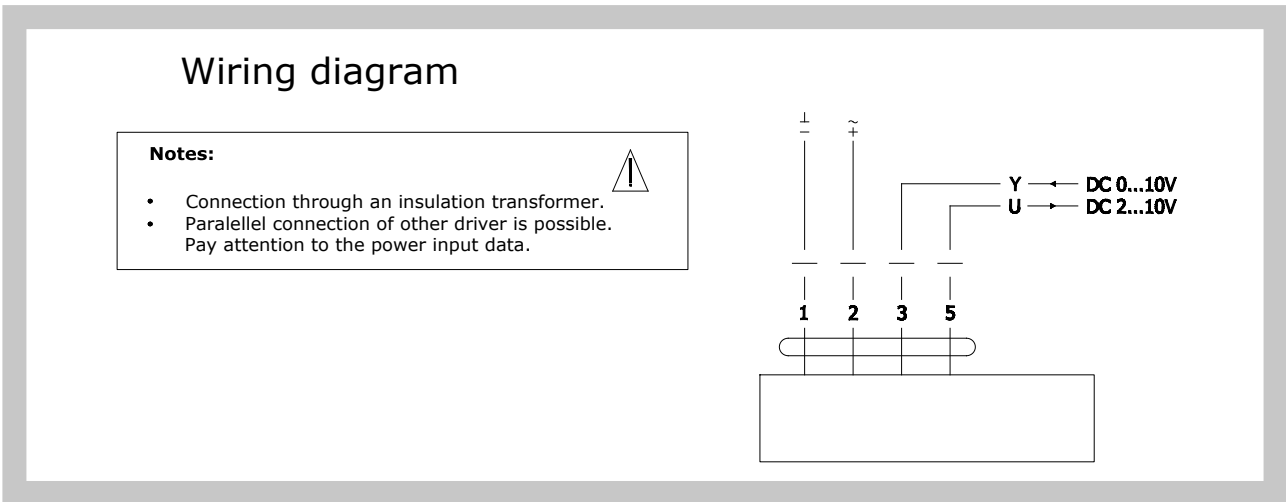

**7. Pressure losses**


**7.1. Pressure losses**

Chart 7.1.1. Pressure losses dependent on the turning of the damper's leaf

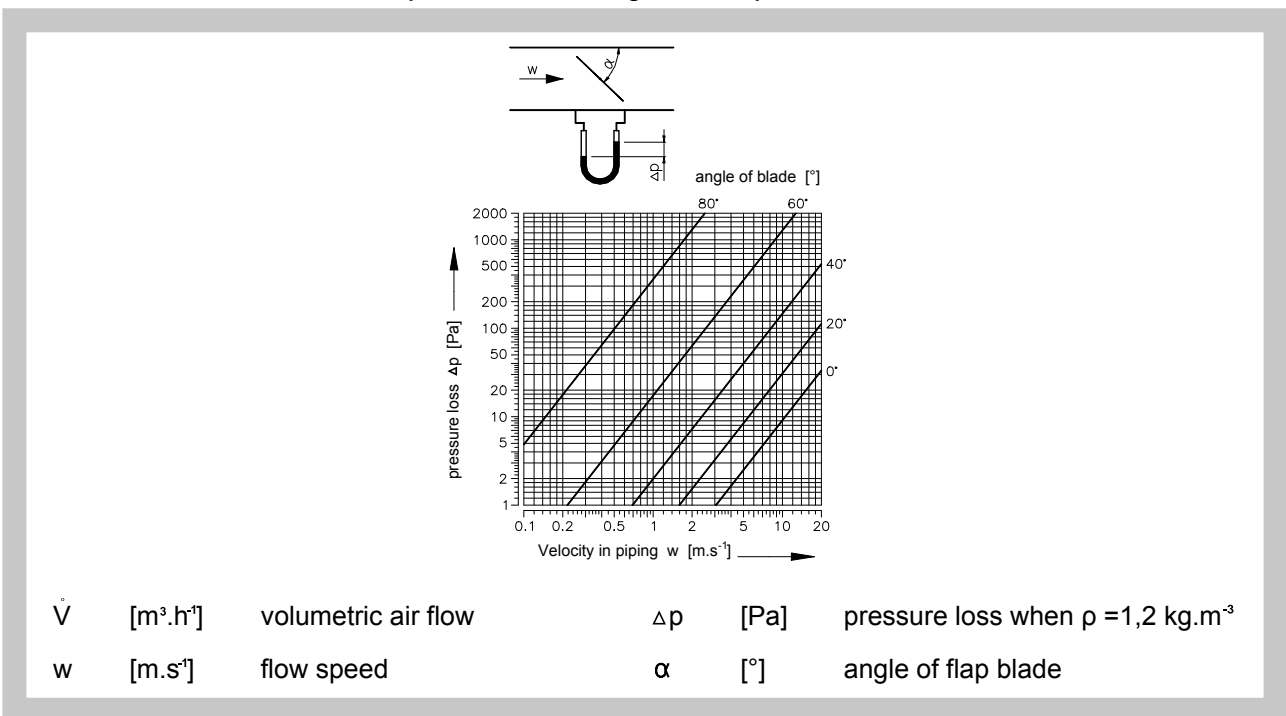

8. Noise data

Chart 8.1. Aerodynamic noise

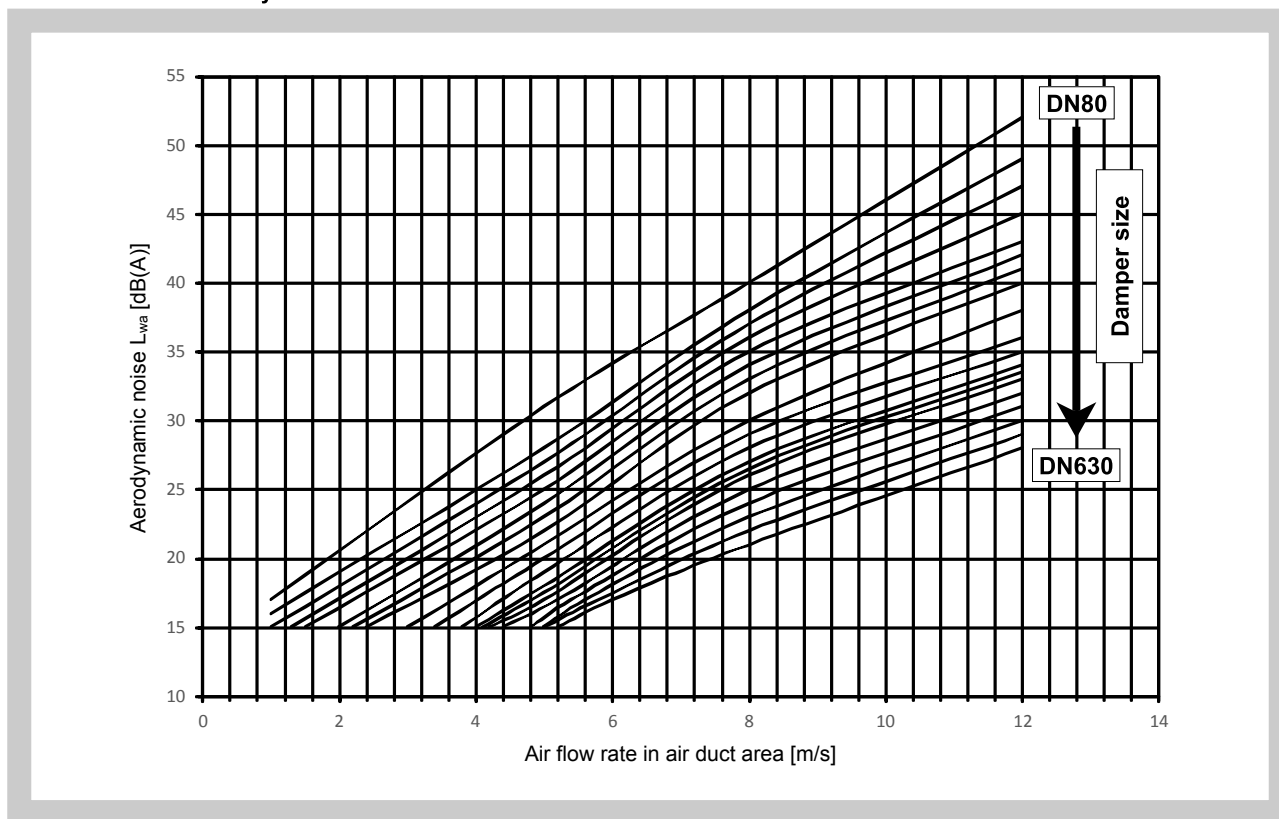

Tab. 8.1. Aerodynamic noise

Nominal Size	$\dot{V}$ [m/s]	L <sub>WA</sub> [dB(A)]	Nominal Size	$\dot{V}$ [m/s]	L <sub>WA</sub> [dB(A)]	Nominal Size	V [m/s]	L <sub>WA</sub> [dB(A)]
80	1	17	200	2,4	15	400	4,4	15
	5	31		5	22		5,2	17
	8	40		8	32		8	25
	12	52		12	40		12	32
100	1	16	225	3	15	450	4,8	15
	5	28		5	21		5,4	17
	8	38		8	30		8	24
	12	49		12	38		12	31
110	1	15	250	3,4	15	500	5	15
	5	27		5	20		5,6	17
	8	37		8	29		8	23
	12	47		12	36		12	30
125	1,3	15	280	3,8	15	560	5	15
	5	26		5	19		5,8	17
	8	36		8	28		8	22
	12	45		12	35		12	29
140	1,5	15	300	4	15	630	5,2	15
	5	25		5	18		6	17
	8	35		8	27		8	21
	12	43		12	34		12	28
160	2	15	315	4,1	15			
	5	24		5	18			
	8	34		8	27			
	12	42		12	34			
180	2,2	15	355	4,2	15			
	5	23		5	17			
	8	33		8	26			
	12	41		12	33			

## IV. MATERIAL, FINISHING

### 9. Material

**9.1.** The body of the damper and the leaf are made of galvanized sheet; the leaf's journals are of steel. Along its circumference, the leaf is fitted with a silicon seal. The version on spiro piping can come with or without a rubber edge seal.

**9.2.** According to the customer's requirements, damper can be made of stainless material.

Specifications for stainless-steel models – classification of stainless steel:

- Class A2 – Food-grade stainless steel (AISI 304 – ČSN 17240)
- Class A4 – Chemistry-grade stainless steel (AISI 316, 316L – ČSN 17346, 17349)

The indicated metal is used for all metal components of the damper except the servo drive and its adapters.

The following components, including the fasteners, are made from stainless steel at all times:

- 1) Damper body and all components permanently attached
- 2) Leaf pins, metal components of the leaf
- 3) Controlling components outside the damper (levers, control levers, metal part of the pin or the entire pin)
- 4) Servo drive mount

Plastic, rubber and silicon components, sealants, servo drives, and end switches are identical for all material variants of the dampers.

Some fasteners and components are available in one class of stainless steel; the type will be used in all stainless-steel variants.

Any other requirements for the design shall be considered atypical and shall be addressed on an individual basis.

### 10. Finishing

**10.1.** The damper is delivered without further surface treatment.

## V. CHECKING, TESTING

### 11. Checking

**11.1.** The dimensions are checked by means of the usual measuring instruments according to the norm for non-tolerable dimensions used in air technology.

**11.2.** Intermediate operation checks of the parts and main dimensions are carried out according to the drawing documents.

### 12. Testing

**12.1.** After the plant assembly, a check of the functioning of the closing mechanism and the electrical components is carried out.

## VI. PACKING, TRANSPORT, STORAGE

### 13. Logistical data

**13.1.** The damper are transported as bulk cargo, using suitable covered means of transport. When agreed upon with the manufacturer, the dampers can be loaded onto palettes. Dampers must be protected from mechanical damage during transport and storage. If packing is used, it is non-returnable and its price is not included in the price of the damper.

**13.2.** If not otherwise agreed, the handover is considered when the goods is forwarded to the carrier.

**13.3.** The dampers must be stored in the indoor environment without any aggressive vapours, gases or dust. Indoor temperature must be in the range from -5°C to +40°C and maximum relative humidity 80%. Dampers must be protected against mechanic damages when transported and manipulated.

**13.4.** The delivery includes a complete damper including the control mechanism.

## VII. ASSEMBLY


### 14. Assembly

**14.1.** The assembly consists of installing the damper in the air distribution system and if required, connecting the actuating mechanism to the electric net. Connection of the actuating mechanism to the electric net can be done only by trained person.

**VIII. ORDERING INFORMATION**

**15. Ordering key**

**RKKT** **100** **P** **-** **.56** **TPM 031/03**

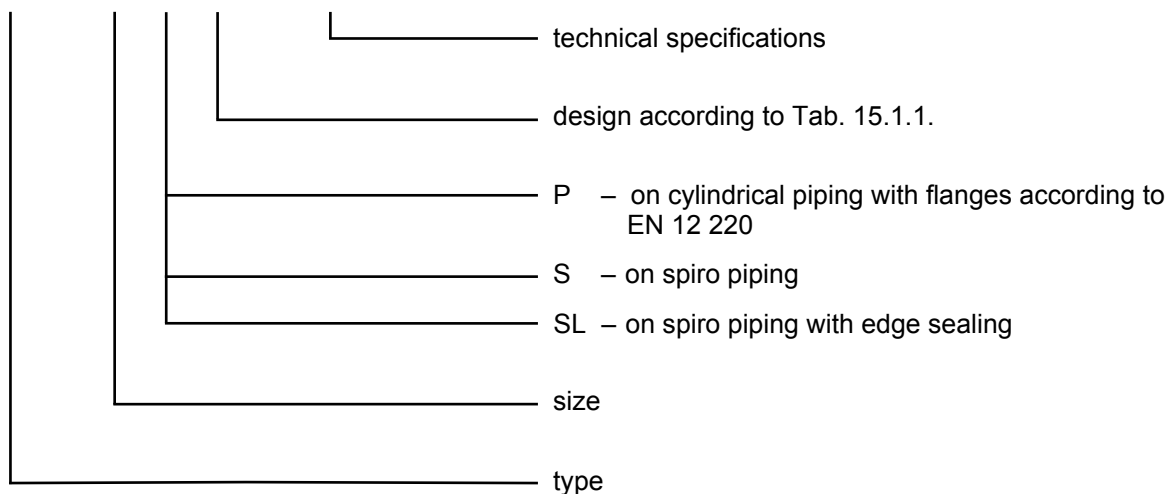

It is necessary to talk with the manufacturer regarding orders for versions with a different type of actuating mechanism.

Tab. 15.1.1. Damper versions are designated according to the manner of control by a double-digit number behind the TP number.

Damper version – type of control	Double-digit number behind the TP number
Manually controlled	.01
to fit actuator drive	.09
Actuator with emergency function 230V	.43*
Actuator controlled 230V, two point regulation without position signal	.45
Actuator controlled 230V, two point regulation with position signal	.46
Actuator with emergency function 230V with position signal	.48*
Actuator with emergency function 24V	.53*
Actuator controlled 24V, two point regulation without position signal	.55
Actuator controlled 24V, two point regulation with position signal	.56
Actuator controlled 24V SR with smooth regulation	.57
Actuator with emergency function 24V with position signal	.58*

\* design is available on request, is necessary to specify the position of the damper blade (open or closed) without voltage.

MANDÍK, a.s.  
Dobříšská 550  
26724 Hostomice  
Czech Republic  
Tel.: +420 311 706 706  
E-Mail: [mandik@mandik.cz](mailto:mandik@mandik.cz)  
[www.mandik.com](http://www.mandik.com)

---

The producer reserves the right for innovations of the product. For actual product information see  
[www.mandik.com](http://www.mandik.com)